


Model 8630 PRESSURA™ Second Pressure Sensor Installation Instructions

Installing with the Model 8630 PRESSURA™ Room Pressure Monitor

The purpose of these instructions is to guide the installer through the installation of the optional TSI second sensor to the premium Model 8630 PRESSURA™ Room Pressure Monitor. The complete Model 8630 PRESSURA™ Room Pressure Monitor installation is covered in the *Model 8630 PRESSURA™ Room Pressure Monitor Installation Instructions*.

The second sensor must be wired per the figure below. Wire should be 24 AWG or larger (supplied). Any modification to the wiring may damage the sensor and Digital Interface Module.

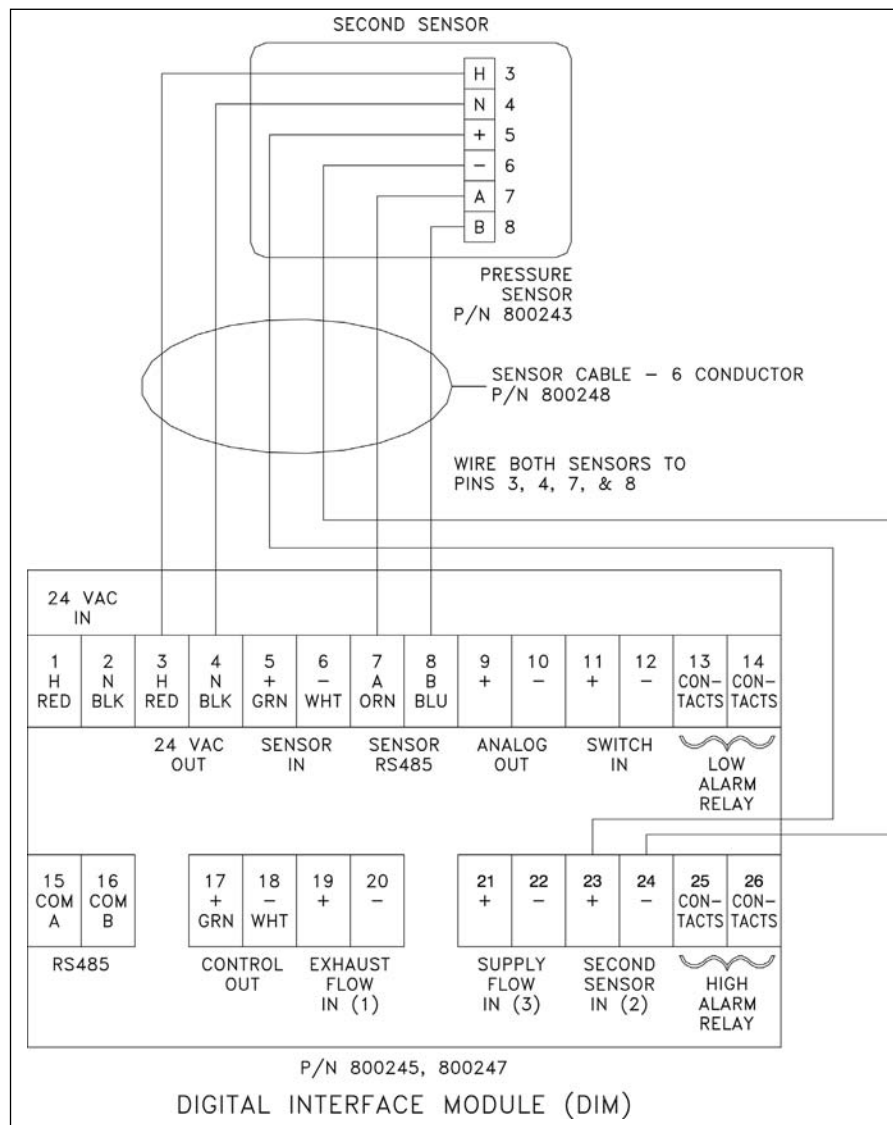

This concludes installation of the second sensor. If you need assistance installing the Digital Interface Module, see the *Model 8630 PRESSURA™ Room Pressure Monitor Installation Instructions*. If you need further assistance, contact your local representative or TSI at 651-490-2811 or 1-800-874-2811.

TSI Incorporated – 500 Cardigan Road, Shoreview, MN 55126 U.S.A

USA	Tel: +1 800 874 2811	E-mail: answers@tsi.com	Website: www.tsi.com
UK	Tel: +44 149 4 459200	E-mail: tsiuk@tsi.com	Website: www.tsiinc.co.uk
France	Tel: +33 491 11 87 64	E-mail: tsifrance@tsi.com	Website: www.tsiinc.fr
Germany	Tel: +49 241 523030	E-mail: tsigmbh@tsi.com	Website: www.tsiinc.de
India	Tel: +91 80 41132470	E-mail: tsi-india@tsi.com	
China	Tel: +86 10 8260 1595	E-mail: tsibeijing@tsi.com	
Singapore	Tel: +65 6595 6388	E-mail: tsi-singapore@tsi.com	



TRUST. SCIENCE. INNOVATION.

Contact your local TSI Distributor or visit our website www.tsi.com for more detailed specifications.