

MODEL 8630


SECOND PRESSURE SENSOR

INSTALLATION INSTRUCTIONS

INSTALLING WITH THE MODEL 8630 PRESSURA

The purpose of these instructions is to guide the installer through the installation of the optional TSI second sensor to the premium Model 8630 PRESSURA. The complete Model 8630 PRESSURA installation is covered in the *Model 8630 PRESSURA Installation Instructions*.

The second sensor must be wired per the figure below. Wire should be 24 AWG or larger (supplied). Any modification to the wiring may damage the sensor and Digital Interface Module.

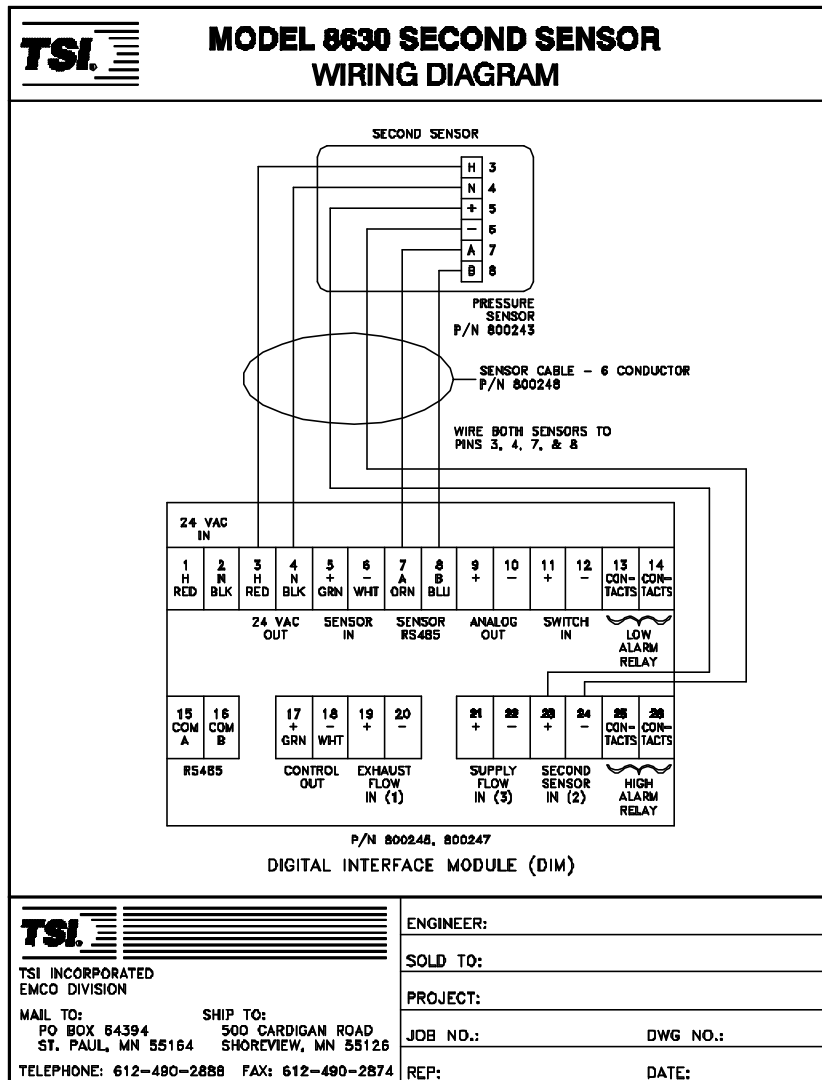

7/15/95

COPYRIGHT ©, 1995 BY TSI INCORPORATED

This concludes installation of the second sensor. If you need assistance installing the Digital Interface Module, see the *Model 8630 PRESSURA Installation Instructions*. If you need further assistance, contact your local representative or TSI at 1-800-876-2685.

Part Number 1980249
August 1995