

MODEL 8630-CRM PRESSURA


CLEAN ROOM PRESSURE MONITOR

INSTALLATION INSTRUCTIONS

WARNING: The Model 8630-CRM Clean Room Pressure Monitor must be wired to 24 VAC only. Wiring the unit to 110 VAC will cause serious damage to the unit and void the warranty.

The pressure sensor must be mounted through the wall between the controlled space (clean room) and referenced space (airlock / hallway).

These installation instructions guide the installer through the installation of the TSI Model 8630-CRM PRESSURA Clean Room Pressure Monitor. Please read these instructions thoroughly before beginning installation.

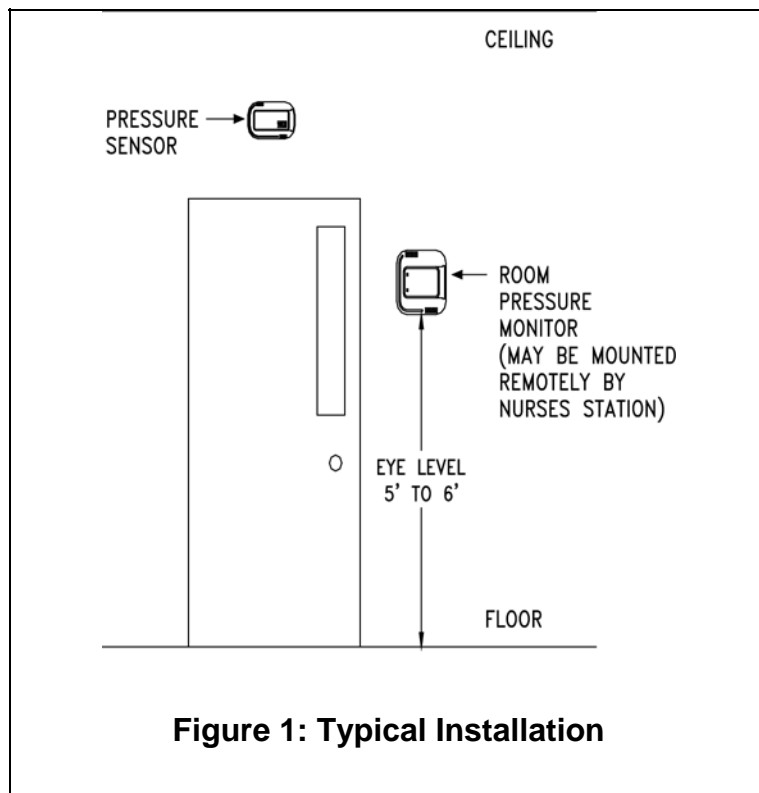

COMPONENT LIST

Part Number	Qty	Description
801914	1	8630-CRM Clean Room Pressure Monitor
800420	1	Transformer
800414	1	Transformer cable
and either 800xxx	1	Pressure Transducer
801913	1	Sensor Port Assembly
800420	1	Transformer
800414	2	Transformer Cable
or		
801912	1	Pressure Sensor Assembly
800248	1	Pressure Sensor Cable

PRESSURE SENSOR INSTALLATION

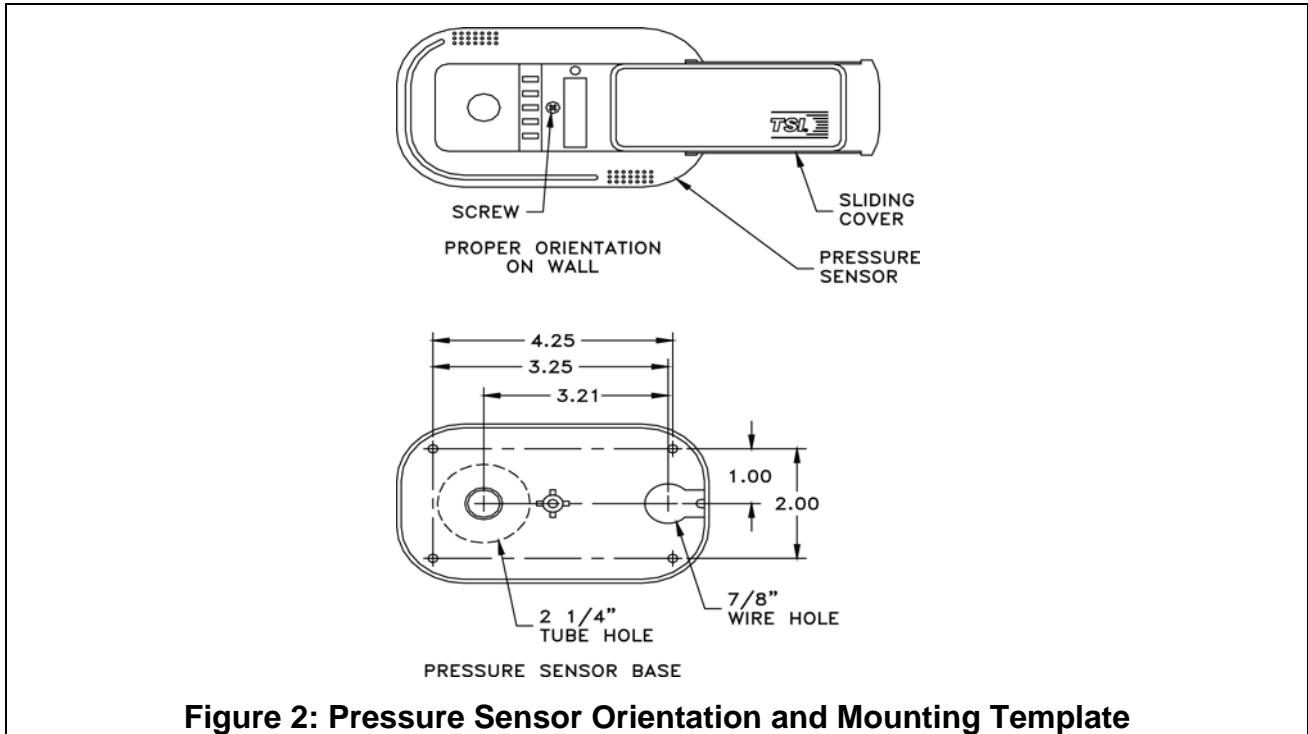


Figure 2: Pressure Sensor Orientation and Mounting Template

WARNING: 801912 pressure sensor must be mounted through the wall between the controlled space (clean room) and referenced space (hallway), exactly as shown in Figure 3 and 4.

Determine pressure sensor location (Figures 1, 2 and 3). Pressure sensor typically mounts in the reference space, and the plate mounts in the clean room.

NOTE: Pressure sensor is not symmetrical. If sensor is to be centered over hallway door, measure one inch to the left of center for 2 1/4" hole.

The pressure sensor must be orientated on the wall as shown in Figure 2. Looking at the mounted sensor, sensor hole is on the left (2 1/4") and wire hole is on the right.

Drill a 2-1/4 inch hole through each side of the wall to accept the sensor tube.

Drill a 7/8 inch hole on the side of the wall that the pressure sensor will be mounted. This hole is for the six-conductor sensor cable. Refer to Figure 2 for a hole mounting pattern.

Slide sensor cover to right and remove screw that holds the sensor base to the pressure sensor (Figure 2). Remove pressure sensor and store in a safe place.

From the side of the wall the sensor will be mounted, slide the sensor tube through the wall. Mark the tube where it is flush with wall. Remove sensor tube and cut tube 1/8 inch shorter than flush marking.

NOTE: If 12" sensor tube is not long enough add a 1" to 2" adapter and extend with 2" OD tube. Do not extend sensor tube with 1" tubing.




From the side of the wall the sensor will be mounted, slide the sensor tube through the wall. Slide the dummy plate over the end of the tube. Screw the pressure sensor base and dummy plate to the wall (Figure 3).

Wire the pressure sensor per Figure 10. Run sensor cable to the Clean Room Pressure Monitor 4" x 4" electrical rough-in box.

Insert fire protection sealant (provided) into 7/8" wire hole to seal.

Install and screw the pressure sensor onto the base. Slide cover to the left to hide the sensor. Finished installation should look as shown in Figure 4.

Warning: Do **not** touch the sensor element in the pressure sensor. Do **not** run wires through the air passage. Doing so will damage the sensing element.

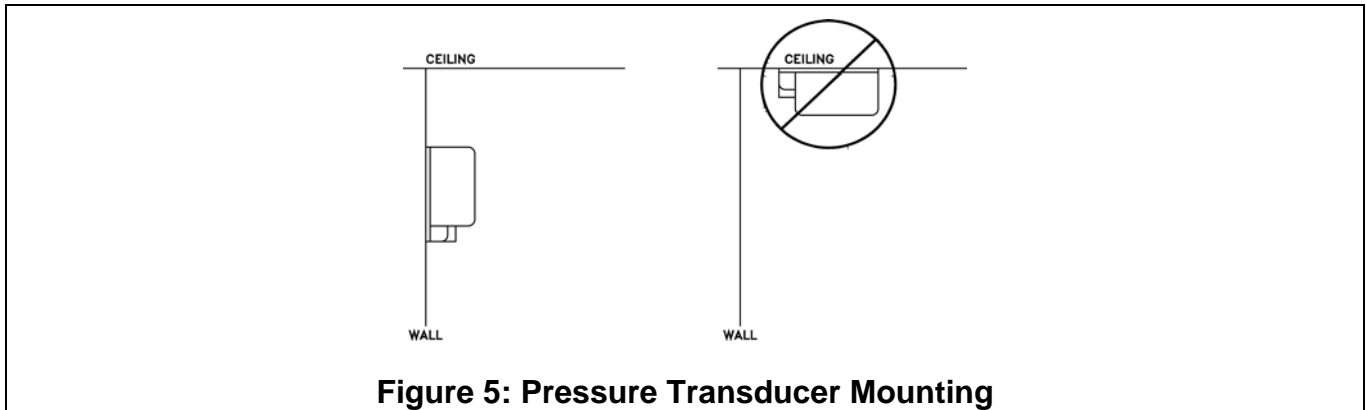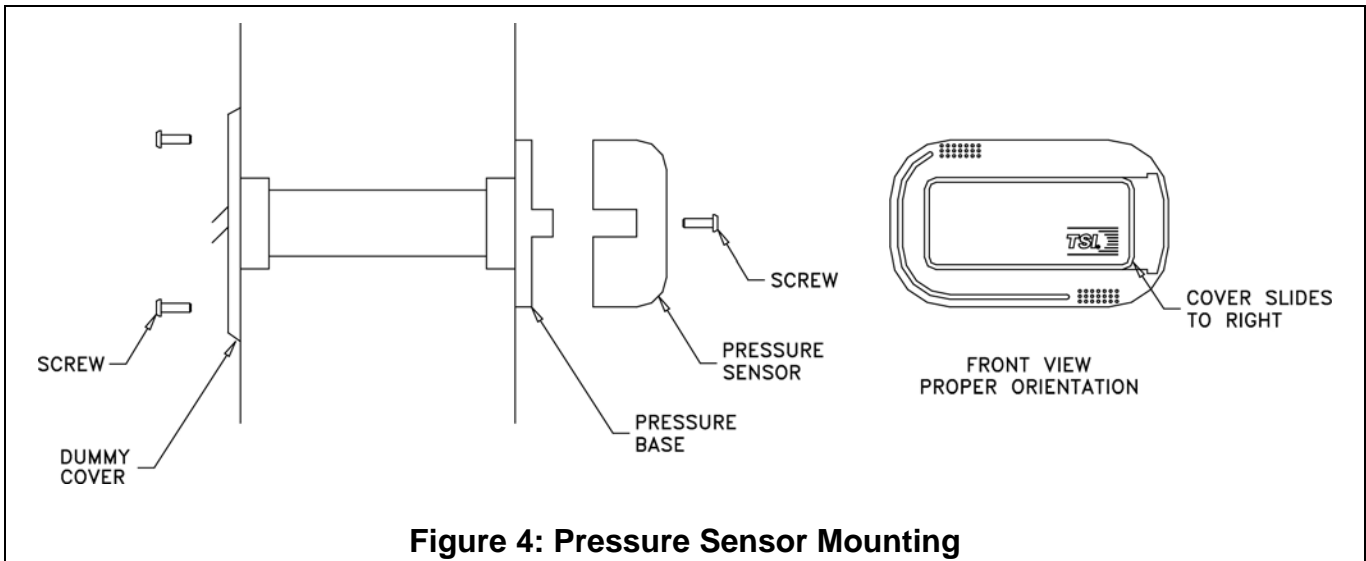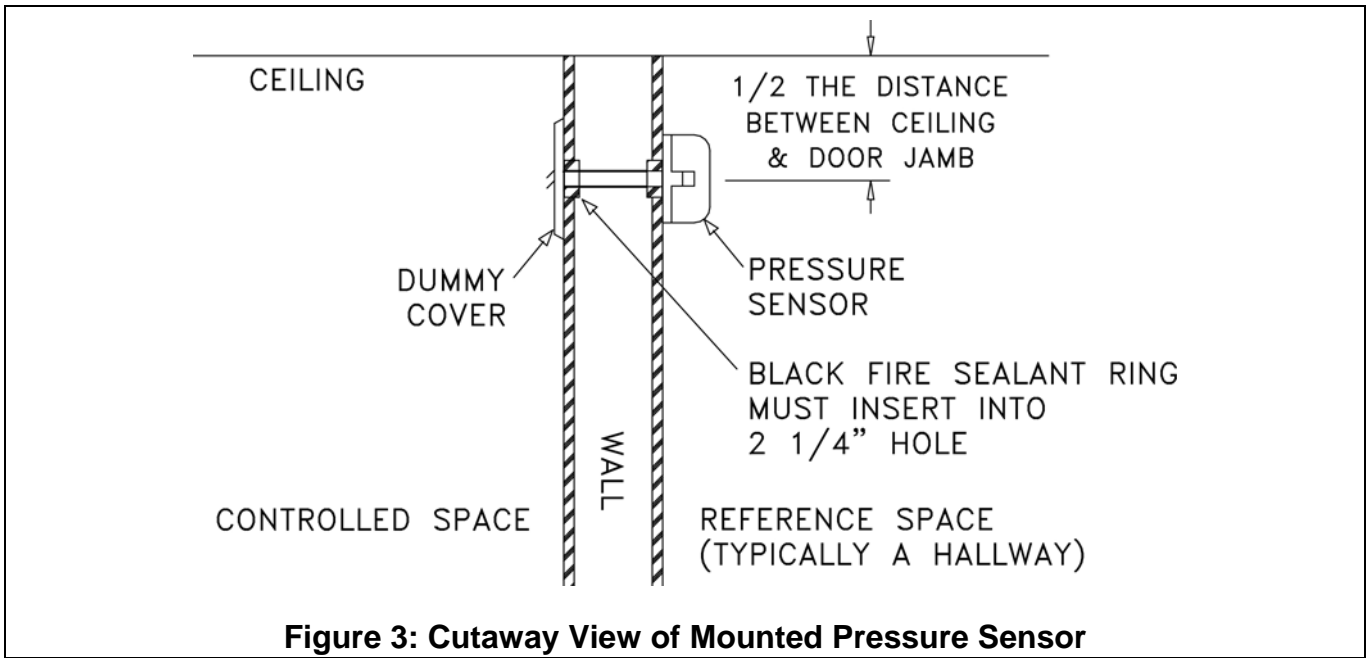

PRESSURE TRANSDUCER INSTALLATION

WARNING: 801913 pressure plates must be mounted in the wall between the controlled space (clean room) and referenced space (hallway), exactly as shown in Figure 6 and 7.

Install pressure transducer in desired location (typically above ceiling). The transducer must be mounted on a wall in the correct position per Figure 5 (screws not provided). Do not mount pressure transducer to duct or other vibrating surface.

Wire the pressure transducer per Figure 11. Run sensor cable to the Clean Room Pressure Monitor 4" x 4" electrical rough-in box.



Determine pressure sensor location (Figures 1, 6 and 7). Pressure sensor typically mounts in the reference space, and the plate mounts in the clean room.

Drill a 2-1/4 inch hole through each side of the wall to accept the sensor tube.

Run pneumatic tubing from transducer to sensor locations. For a positively pressurized space, the high port should be connected to the controlled space and the low port to the reference space. Similarly, for a negatively pressurized space, the low port should be connected to the controlled space and the high to the reference space.

Connect the pneumatic tubing to the nipple on the back side of the pressure plate.

Insert the pressure plate into the hole in the wall. Screw the pressure plate to the wall. The finished assembly should look like figure 6.

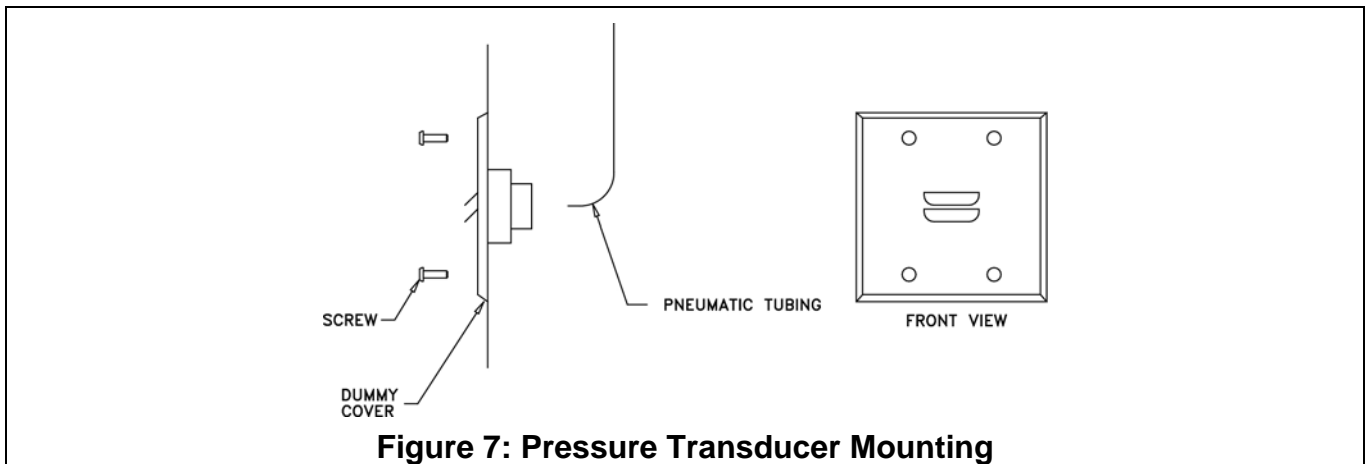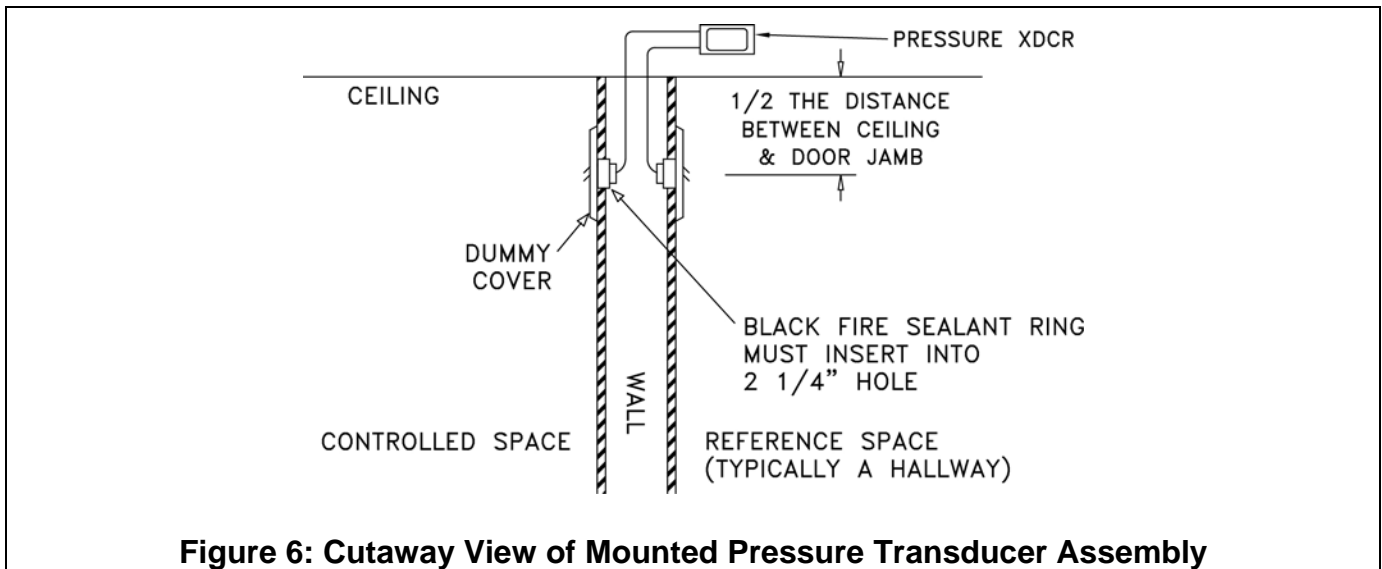

TRANSFORMER INSTALLATION

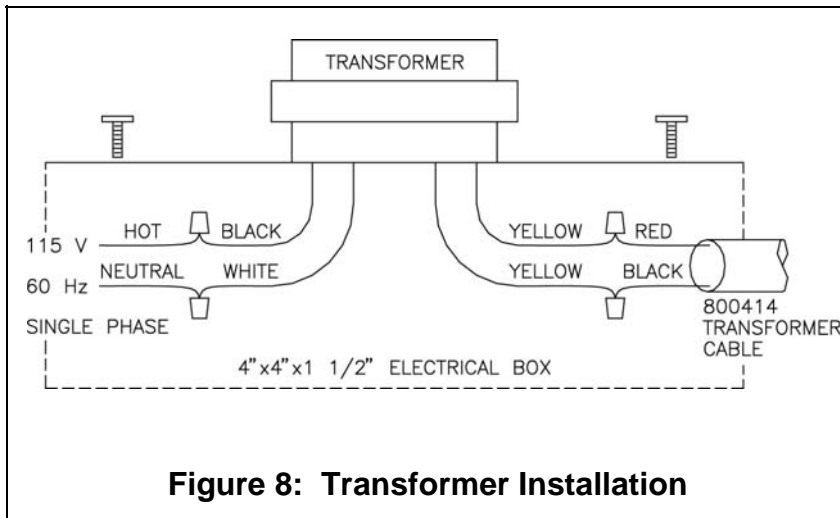


Figure 8: Transformer Installation

WARNING

Make sure no power is applied until all wiring is complete.

Follow all applicable electrical codes, and have qualified personnel install the transformer.

NOTE

Each system must be installed with supplied transformer. If TSI transformer is discarded and a central transformer is installed, a separate clean transformer must be installed in line between the TSI system and central transformer.

Mount a standard 4" X 4" x 1-1/2" electrical box at a convenient location within 20 feet of pressure monitor.

Run 115 Volt, single phase, 60 hertz line voltage (115 VAC) to electrical box. Follow all applicable electrical codes.

Connect 115 VAC line voltage HOT wire to BLACK wire on transformer and NEUTRAL wire to WHITE wire on transformer (Figure 8).

Connect the RED wire on 800414 transformer cable to either YELLOW wire on the transformer and the BLACK wire to the remaining YELLOW wire.

Screw the transformer to the electrical box.

Run transformer cable from the transformer electrical box to the pressure monitor. Have at least 8 inches of cable coming out of the pressure monitor rough in electrical box before trimming cable to length.

PRESSURE MONITOR INSTALLATION


Pressure Monitor Rough-in

Select the mounting location of the pressure monitor. The construction plans normally show the mounting location. If no location is specified, then the unit is typically installed as shown in Figure 1.

Install a standard double gang electrical box (4" x 4").

Slide the pressure monitor cover to the right and remove three screws holding the electronics to the base (Figure 9). Remove base.

Install the base to the 4" x 4" electrical box. The base's "THIS SIDE UP" arrow must be pointing towards the ceiling

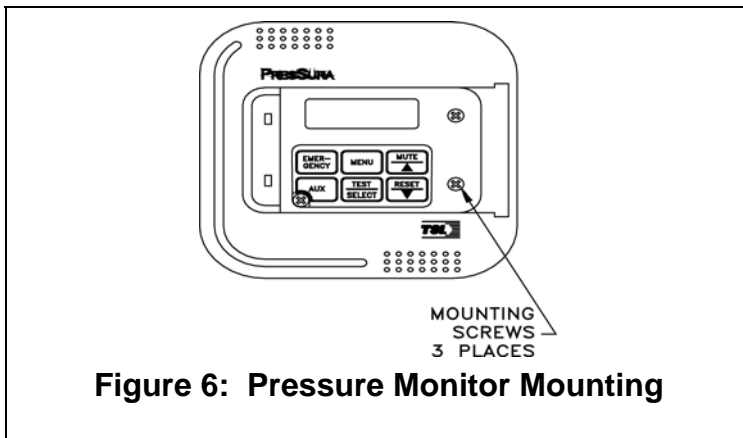

NOTE: Two screws are hidden behind the cover when full open. The cover will slide to the right approximately 2 inches until a stop is hit. Pull cover to completely remove from electronics and expose the screws.

Pressure Monitor Wiring

WARNING: Do **not** connect more than 24 VAC to any terminal.

Do **not** apply voltage to the RS-485 output or analog output. Severe damage may occur to the unit if voltage is applied.

Remove the connectors from the back of the pressure monitor.

Refer to the wiring diagram (Figures 10 and 11) for proper wiring installation.


If additional options need to be wired, refer to building prints for proper wiring diagram.

Plug the connectors back into the pressure monitor.

Carefully push the wires into the electrical box and mount the pressure monitor. Install three screws to hold pressure monitor firmly to base. Install cover and slide left to hide display.



MODEL 8630 - CRM MONITOR WIRING DIAGRAM - TSI PRESSURE SENSORS

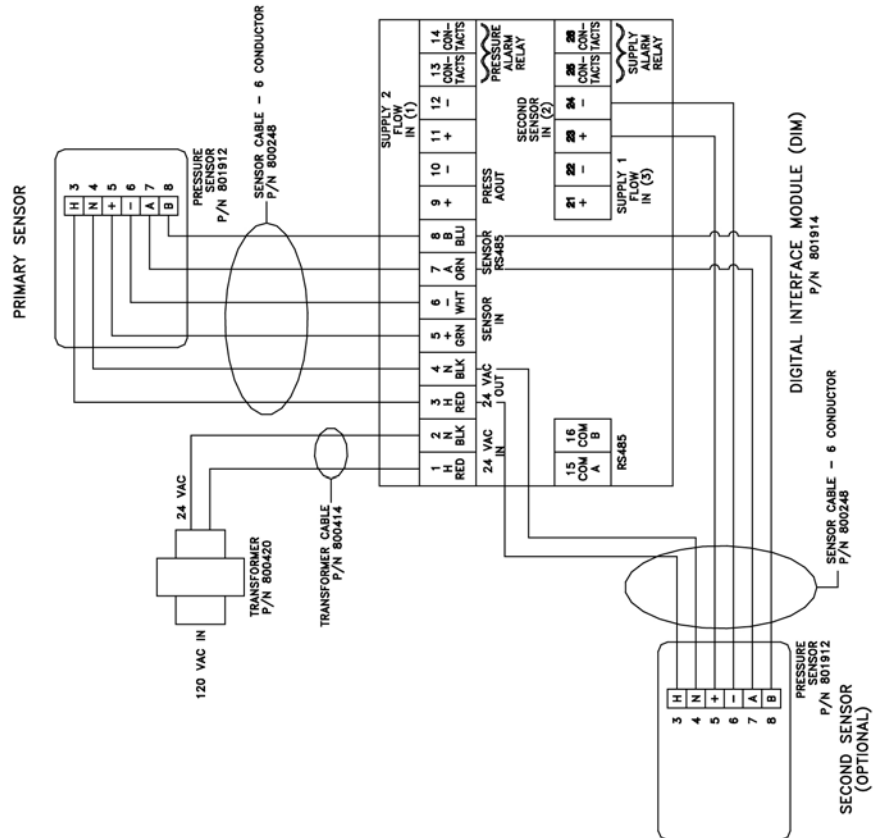

TSI Incorporated
500 Cardigan Road
Shoreview, MN 55126
Telephone: 651-490-2811 Fax: 651-490-3824

ENGINEER:

SOLD TO:

PROJECT:

JOB NO.:

DWG NO.:

REP:

DATE:

8/14/00


COPYRIGHT ©, 2000 BY TSI INCORPORATED

Warning: Monitor must be wired exactly as wire diagram shows. Making modifications to the wiring may severely damage the unit.

Figure 10: Wiring Diagram



MODEL 8630 - CRM MONITOR WIRING DIAGRAM - PRESSURE XDCR

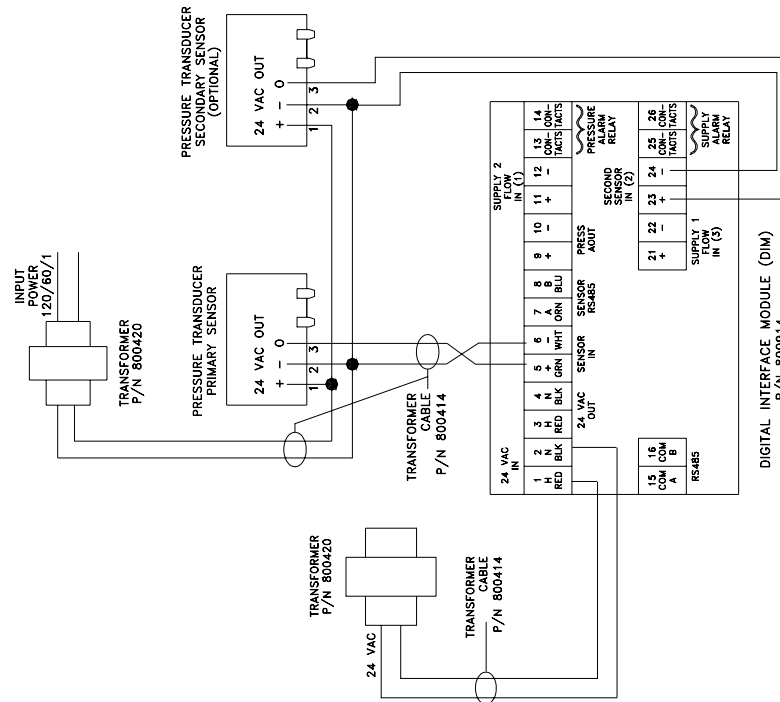

TSI INCORPORATED
500 CARDIGAN ROAD
SHOREVIEW, MN 55126

TELEPHONE: 800-874-2811 FAX: 651-490-2874

ENGINEER:	
SOLD TO:	
PROJECT:	
JOB NO.:	DWG NO.:
REP:	DATE:

JAN/14/2003

COPYRIGHT ©,2003 BY TSI INCORPORATED

Warning: Monitor must be wired exactly as wire diagram shows. Making modifications to the wiring may severely damage the unit.

Figure 11: Wiring Diagram

NOTE: If you need assistance installing the system, call TSI at (800) 874-2811.

Part Number 1980421, Rev. B
February 2003